


8. Thermoelectric Powerstation

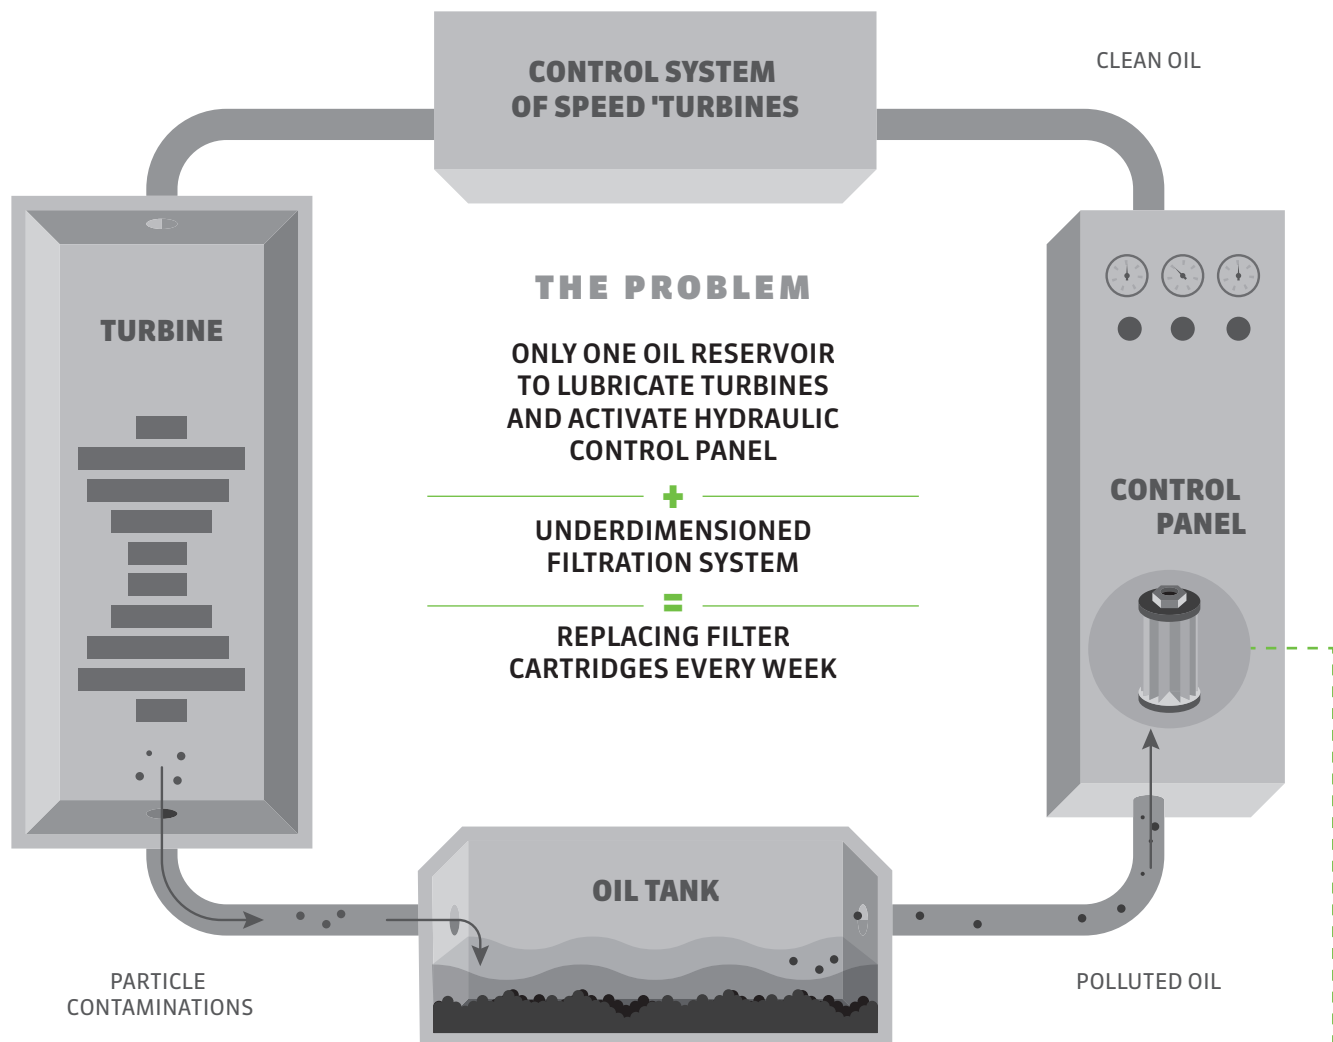


LA RICAMBI UDINESE SUPPLY

La Ricambi Udinese analyzed the plant and prepared ideal dimensioning for the entire turbines system, passing by a filtration underdimensioned to one adequate to the real needs of the system accordingly with cleanliness levels required from valves used in aeronautics.

BEFORE



AFTER



HOW MUCH WAS THE SAVING?

**THE POWERSTATION
REPLACED A FILTER OF 450
EURO EVERY WEEK**

**= € 1.800/MONTH
= € 21.600/YEAR**

**AFTER THIS INTERVENTION,
THE CUSTOMER HAS SPENT
ONLY 4.200 EURO IN A YEAR**